
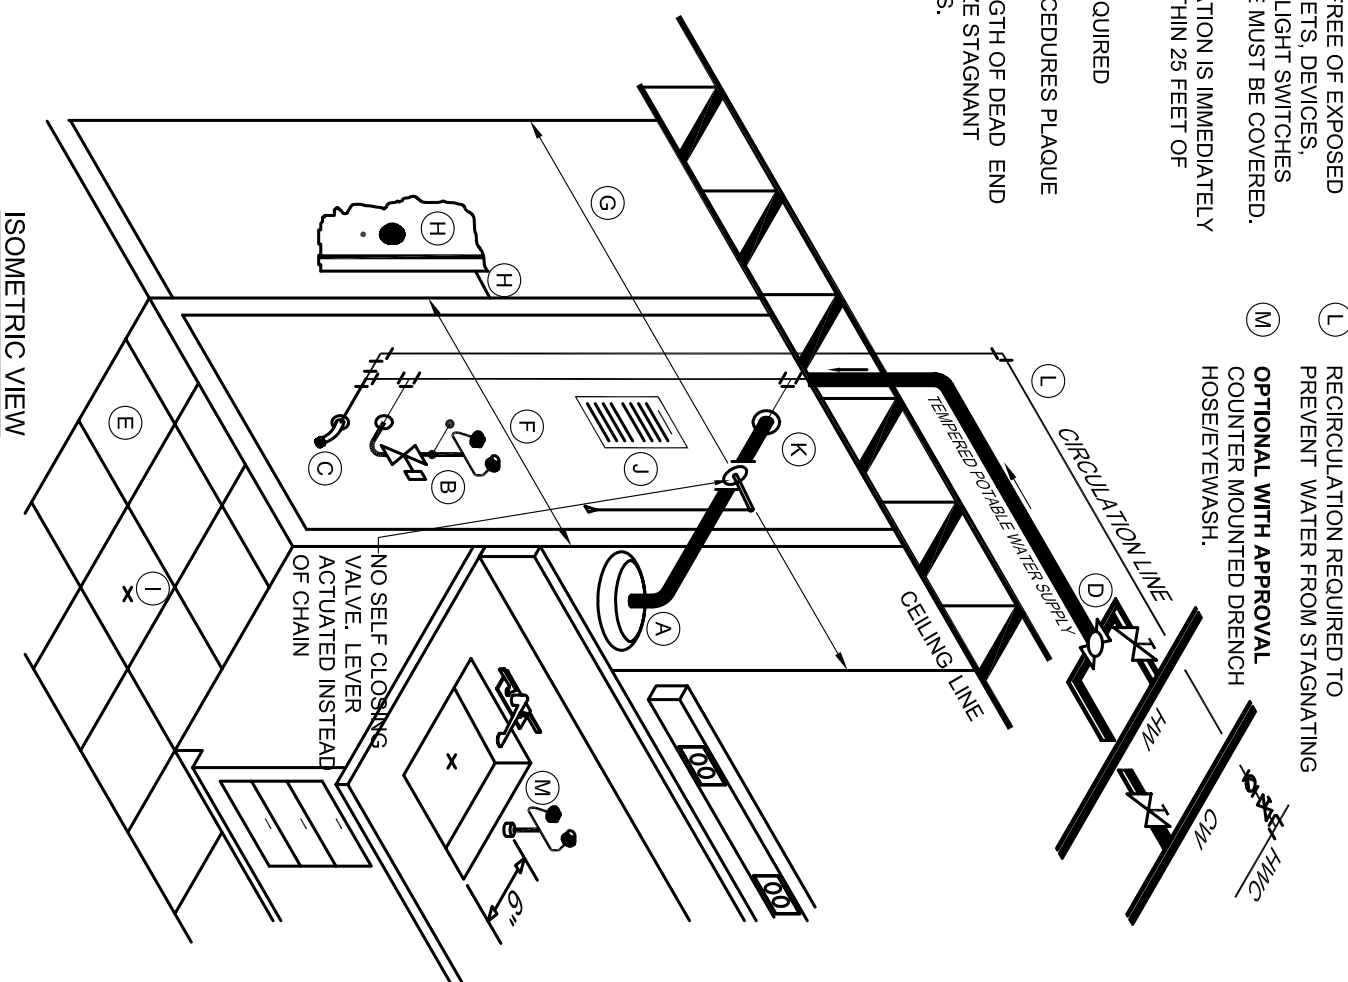


KEYED NOTES

- (A) SAFETY SHOWER HEAD - 7 FT. AFF (SUPPORTED FROM ABOVE).
- (B) EYEWASH STATION - 3 1/2 FT. TO 4 FT. AFF (SUPPORTED WITH WALL BRACKET).
- (C) LINE CLEANOUT CONNECTION (3/4 IN. HOSE BIBB WITH HANDLE REMOVED).
- (D) EMERGENCY MIXING VALVE (INSTALL IN AN ACCESSIBLE LOCATION)
- (E) 3 FT. WIDE x 3 1/2 FT. ± CONTRAST FLOOR TILE AREA (CENTERED BELOW SHOWER).
- (F) 3 FT. WALL ZONE CLEAR OF OBSTRUCTIONS (STRIPED OR PAINTED).
- (G) 6 FT. WIDE ZONE FREE OF EXPOSED ELECTRICAL OUTLETS, DEVICES, EQUIPMENT, ETC. LIGHT SWITCHES WITHIN THIS ZONE MUST BE COVERED.
- (H) PREFERRED LOCATION IS IMMEDIATELY AVAILABLE OR WITHIN 25 FEET OF THE FUME HOOD.
- (I) FLOOR DRAINS REQUIRED
- (J) EMERGENCY PROCEDURES PLAQUE
- (K) MINIMIZE THE LENGTH OF DEAD END PIPING TO MINIMIZE STAGNANT WATER PROBLEMS.
- (L) RECIRCULATION REQUIRED TO PREVENT WATER FROM STAGNATING
- (M) **OPTIONAL WITH APPROVAL**
COUNTER MOUNTED DRENCH HOSE/EYEWASH.

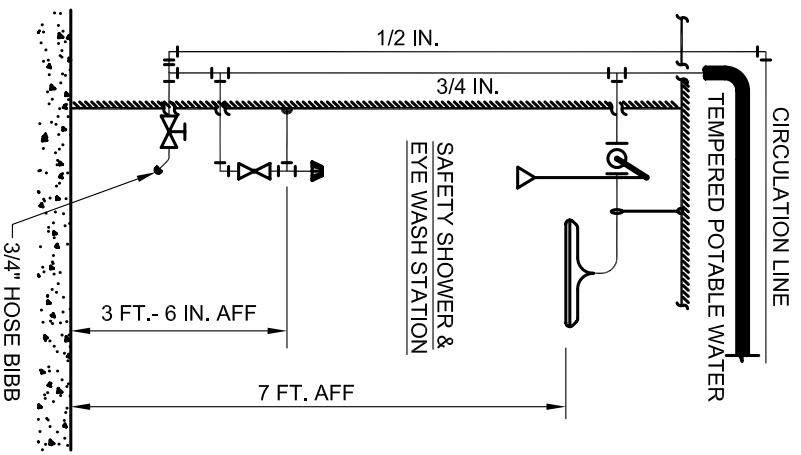

EMERGENCY EYEWASH & SAFETY SHOWER INSTALLATION